



PLAN
1:20

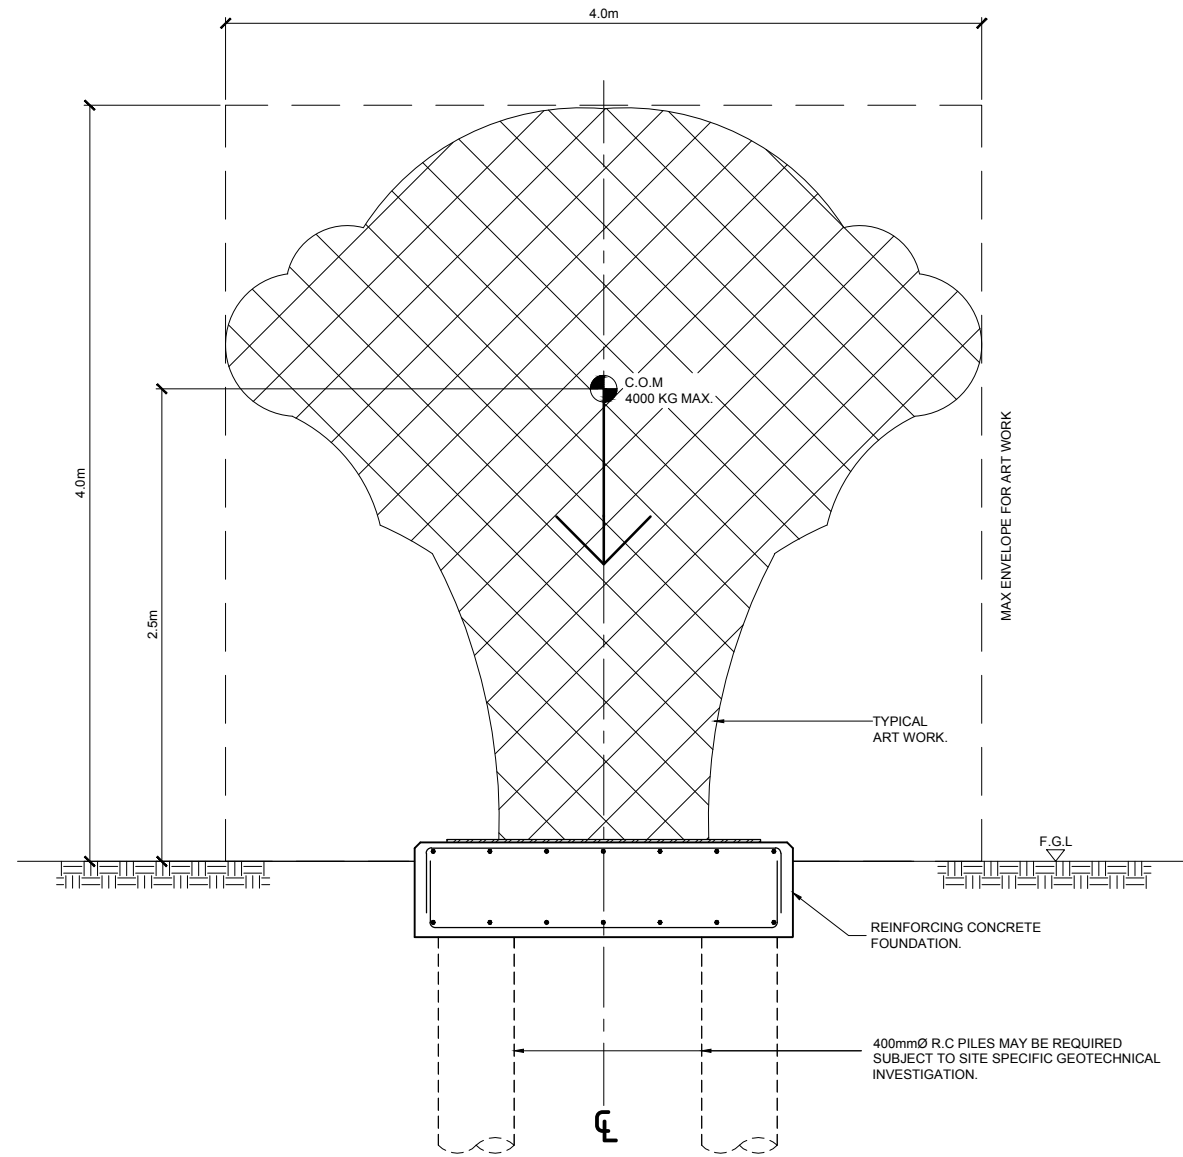


ELEVATION
1:20

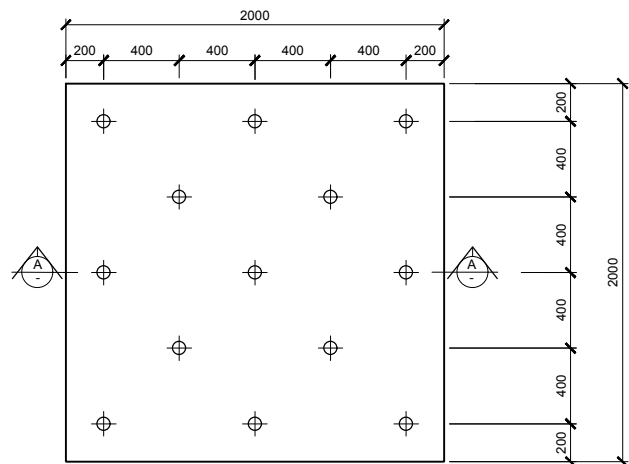

FOUNDATION PLAN
1:20

(SHOWING SETOUT FOR THREADED INSERTS (TBC))

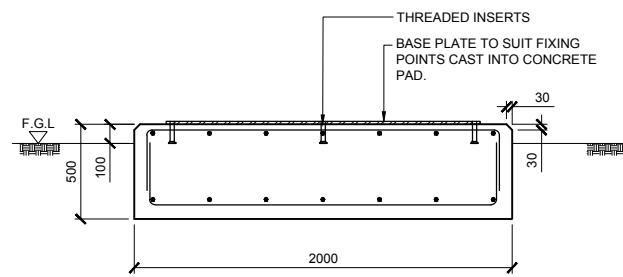

SECTION A-A
1:20

**NOT FOR CONSTRUCTION
CONCEPT ONLY**

NOTES:

- CONCRETE STRENGTH $f_c = 25\text{MPa}$ MINIMUM @ 28 DAYS
- FOUNDATION PAD DESIGNED ASSUMED GOOD GROUND CONDITION WITH 100 kPa ALLOWABLE SOIL BEARING PRESSURE.
- SPECIFIC BRIDGING DESIGN REQUIRED IF FOUNDATION PAD WITHIN THE ZONE OF INFLUENCE OF PUBLIC DRAIN & SERVICES.
- ALL GRADE 500MPa STEEL IS TO BE MICRO ALLOY (MA). NO GRADE 500MPa STEEL IS TO BE REBENT.

Mitchell Vranjes
CONSULTING ENGINEERS
 ■ Ground Floor 2 Karl Street Grafton Auckland
 Box 65248 Mairangi Bay Ph.307-2141 Fax.307-2143
 ■ 2nd Floor 37 Elliott Street Papakura
 Box 72-799 Papakura Ph.298-8800 Fax.298-9920

Job Title:
**PROPOSED SUFFRAGE FOUNDATION:
AUCKLAND COUNCIL**

Sheet Title:
PLAN, ELEVATION & DETAILS

Scale: 1:20 (A1)	Job No: 18/09
Date: MAY 2018	Dwg. No: S.1
Design: NICK.C	Drawn: TED.G
Revisions:	